



REVISION No. 9

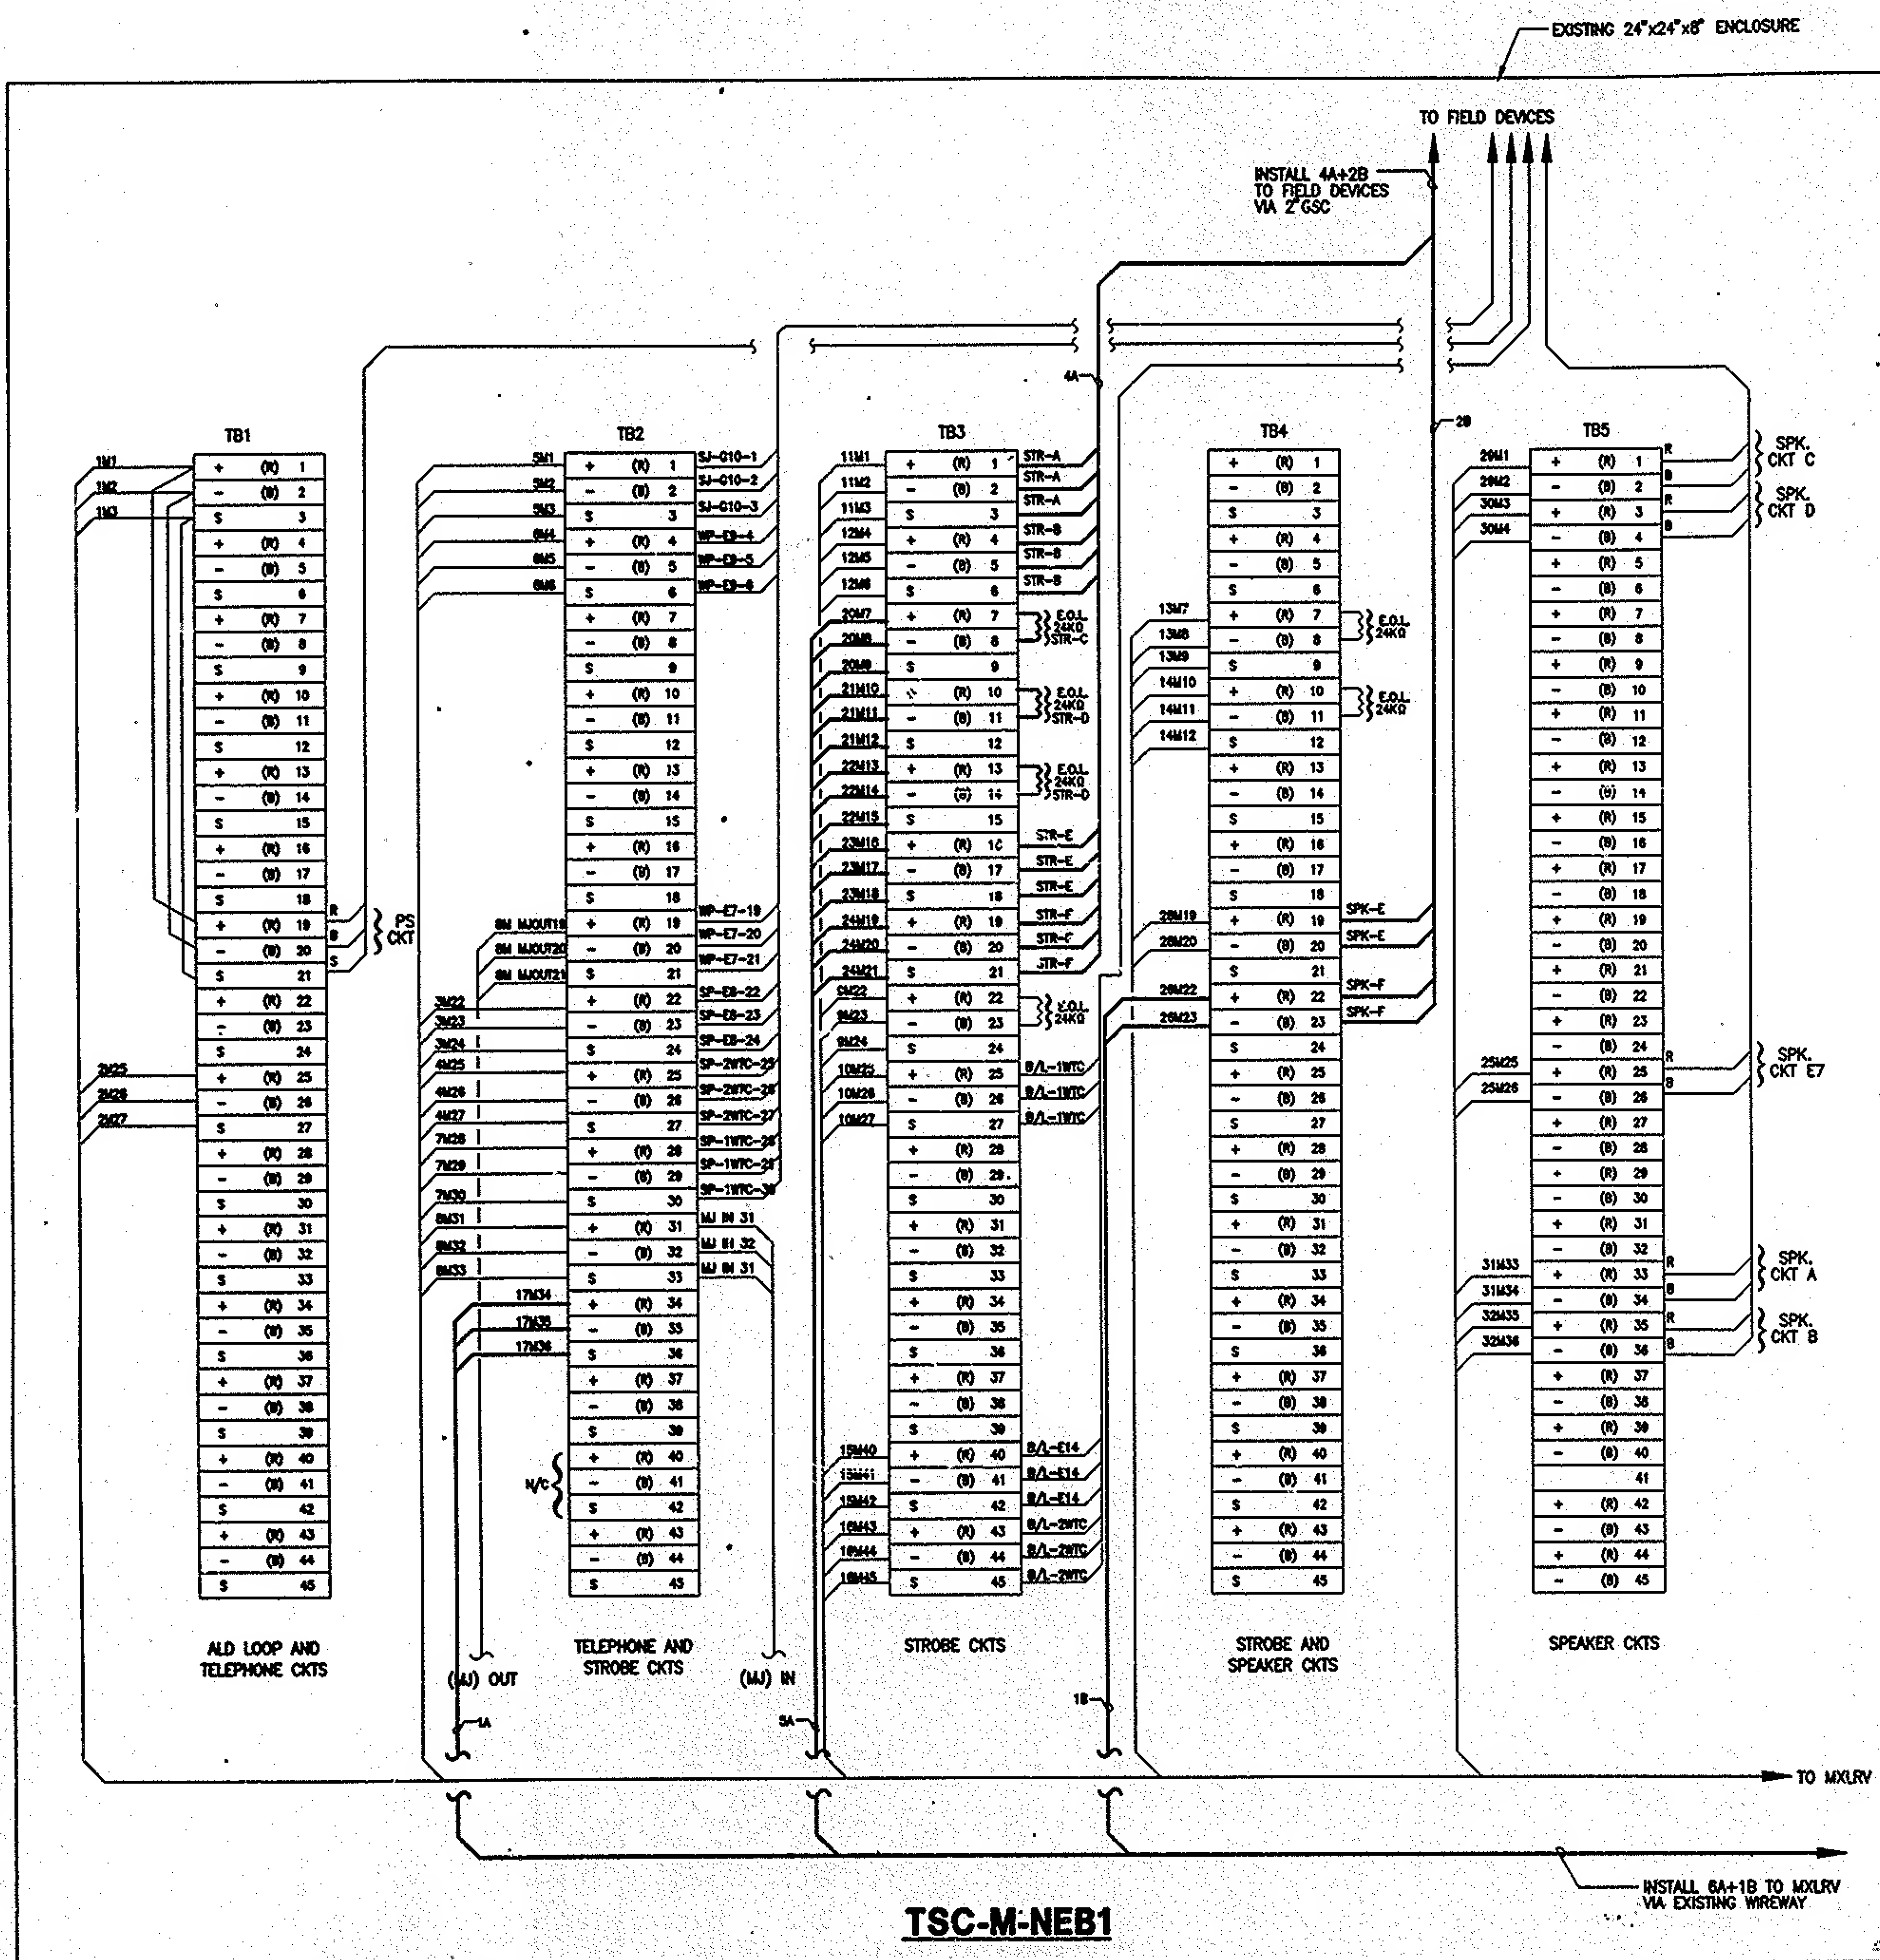

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES.
2. ALL SHIELDS MUST BE ISOLATED FROM GROUND. TUBING SHALL BE USED ON ALL DRAIN CONDUCTORS (C) THIS DWG).
3. ALL WIRING SHALL BE FREE OF GROUND FAULTS, STRAY VOLTAGES.
4. CONTRACTOR SHALL SHUT, TEST AND LABEL ALL CONNECTIONS SHALL BE MADE BY CONTRACTOR IN AND UNDER THE DIRECT SUPERVISION OF THE EN.
5. FOR TSC-M-NEB1 ENCLOSURE LOCATION, SEE DW.

LEGEND:

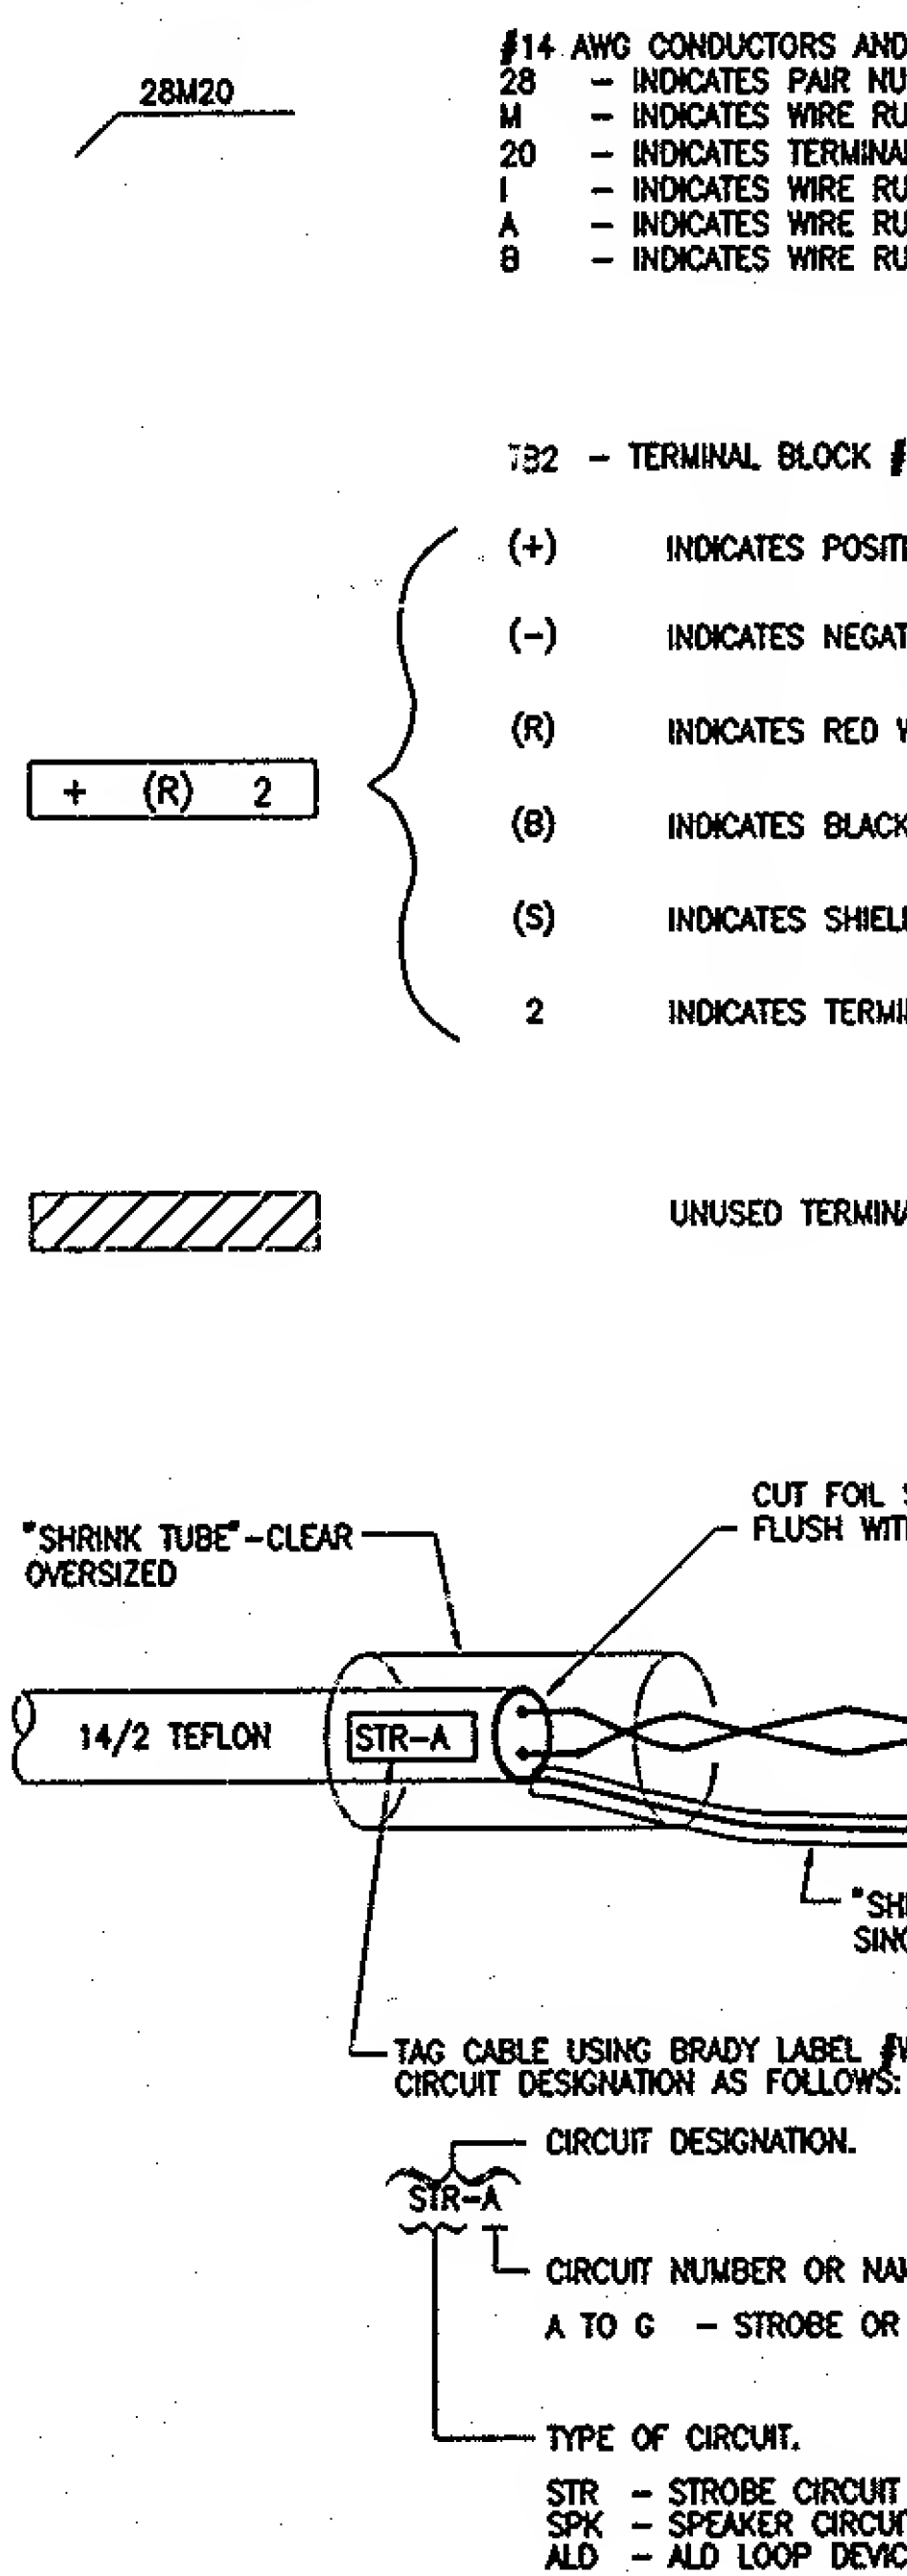

DETAIL "A" - TYPICAL SHIELD/DRAIN

I HEREBY CERTIFY THAT THE DRAWINGS AND SPECIFICATIONS ARE CORRECT AND COMPLETE AND THAT I AM A duly Licensed Professional Engineer in the State of California. My License No. is 12345. I was executed on the 12th day of 1999.

DATE 12/12/99

DATE 12/12/99